


NOTE: ALL UNIVERSAL INPUTS USED WITH DRY CONTACTS REQUIRE +24VDC


DTL-200.1

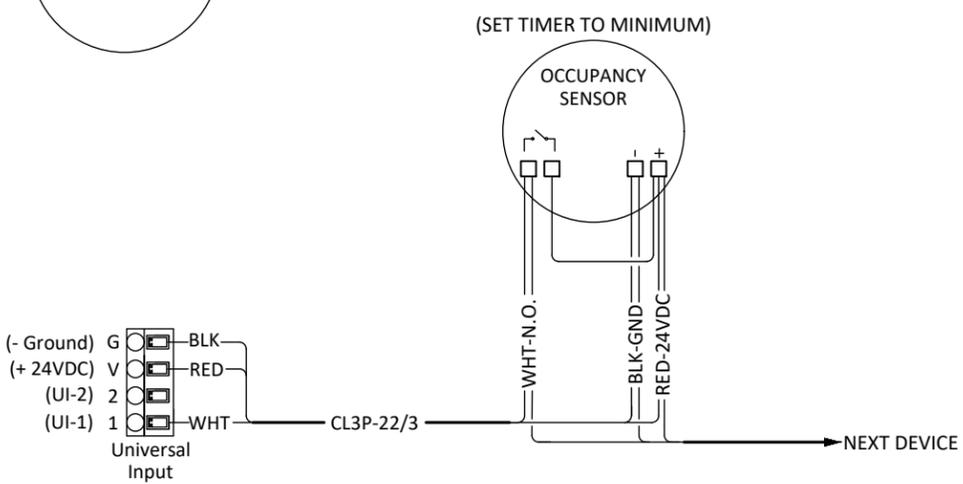

OCCUPANCY SENSOR


NOTE: ALL UNIVERSAL INPUTS USED WITH DRY CONTACTS REQUIRE +24VDC

DTL-200.3

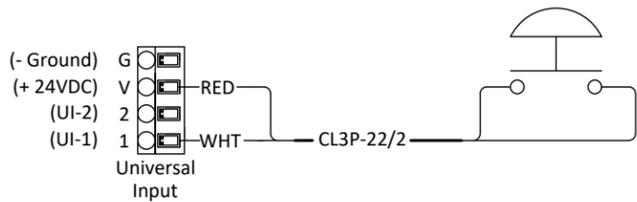

MOMENTARY PUSH BUTTON  
 or  
 MAINTAINED SWITCH


DTL-200.5

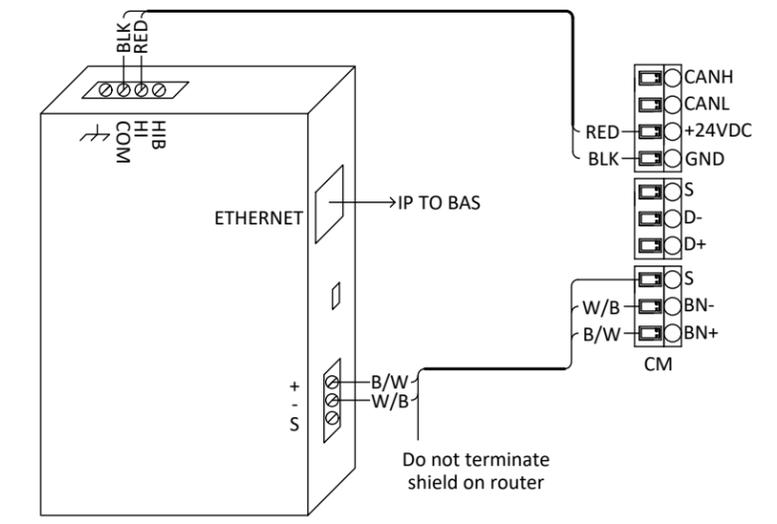

BASRT-B BACNET MS/TP TO IP ROUTER

NOTE: CM DIP SWITCH #6 MUST BE TURNED ON FOR MS/TP TERMINATION.



DTL-200.2

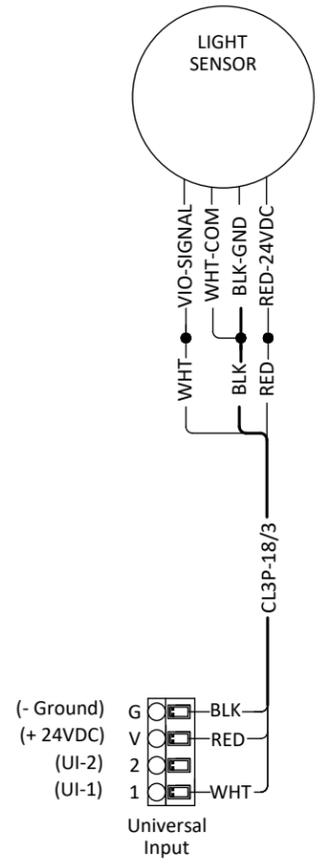

LIGHT SENSOR


NOTE: ALL UNIVERSAL INPUTS USED AS DRY CONTACTS REQUIRE +24VDC

DTL-200.4

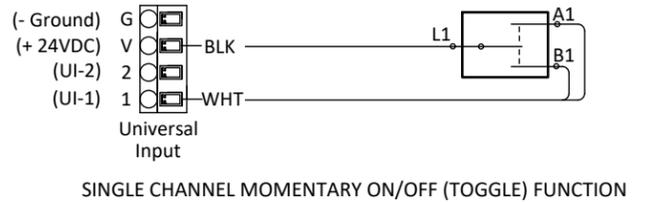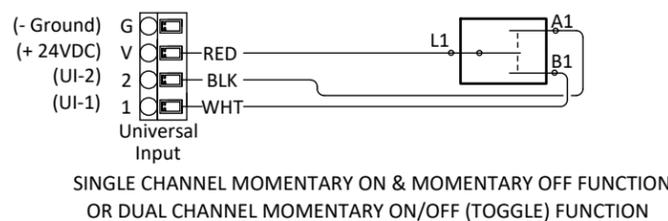

LEVITON 1256-W SPDT MOMENTARY SWITCH

DTL-200.6

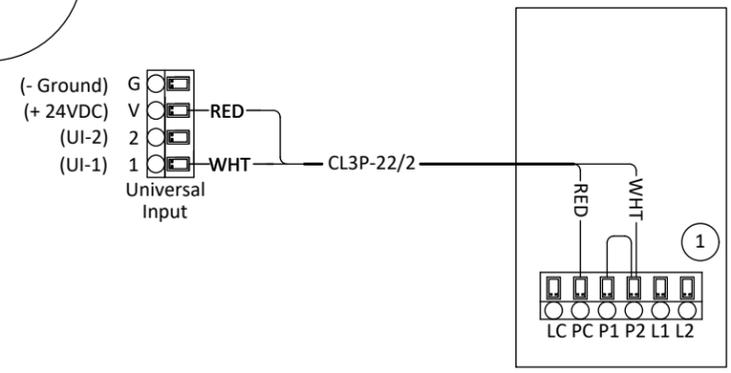

TT-K3M-W MOMENTARY KEY SWITCH  
 BI-DIRECTIONAL TOGGLE - SINGLE UNIVERSAL INPUT

1 SWITCH PIN FUNCTIONS  
 PC - KEY SWITCH COMMON  
 P1 - CLOCKWISE KEY TURN SWITCH  
 P2 - COUNTER CLOCKWISE KEY TURN SWITCH

ENGINEERING STANDARDS DETAIL SHEET 200			
Typical Class-II Wiring			
Rev: 1.06	Type: Wiring Typical	Date: 04/1/2025	Job #:
			Engineered: WCD
			Drawn: ZDS
			Checked: WCD
UNIFIED LIGHTING CONTROL			Page 1 of 1